



TYPE A THRU CURB DRAIN  
SECTION B-B

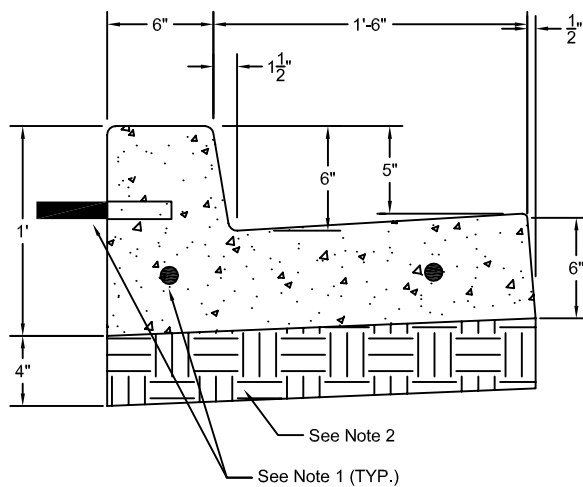

TYPE E THRU CURB DRAIN  
SECTION A-A

## GENERAL NOTES

1. #4 REBAR DOWELS, 6" MINIMUM DEPTH INTO EXISTING SIDEWALK, CURB & GUTTER. DO NOT DOWEL PRIVATE IMPROVEMENTS INTO PUBLIC IMPROVEMENTS.
  2. 4" MINIMUM CLASS 2 A.B. COMPACTED TO 90%
  3. 1/2" DEEP CONTRACTION JOINTS AT 20', 1/4" DEEP CONTRACTION JOINTS AT 10'
  4. PIPE TO BE EITHER SCH 40 PVC OR CAST IRON
  5. ALL CONCRETE SHALL BE 6 SACK 3/4" WITH ONE POUND LAMP BLACK PER CUBIC YARD  
FINISH TO BE UNIFORM FINE BROOMED TEXTURE
  6. IF TYPE A CURB & GUTTER IS IN GOOD CONDITION, CONTRACTOR MAY CORE DRILL WITH ENGINEER APPROVAL.
  7. ASPHALT TO BE HMA 1/2" FINE
  8. UNLESS OTHERWISE NOTED, ALL RADII TO BE 1/2"
- 

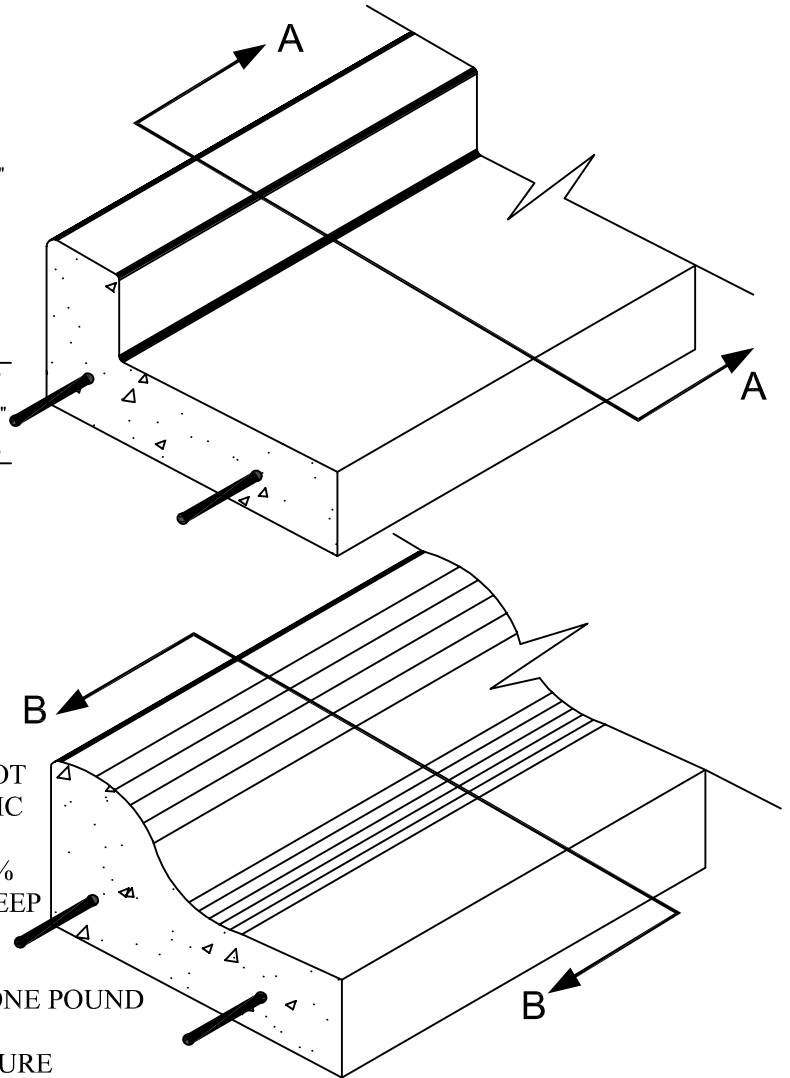

**CITY OF BELMONT**  
DEPARTMENT OF PUBLIC WORKS  
**TYPE A & E CONCRETE**  
**CURB AND GUTTER**

DWG No.

APPROVED  
JAN 2013 NOT TO SCALE